

# Renewable Energy Source Based Hybrid Power Plant for Electric Vehicle (EV) Charging Station in Rural Area

Liney Ajay J<sup>1</sup>, Dhananjayan S. P<sup>2</sup>, Gowtham V<sup>3</sup>, Venkatesh S<sup>4</sup>

Assistant Professor, Department of Electronics and Electrical Engineering<sup>1</sup>

UG Student, Department of Electronics and Electrical Engineering<sup>2,3,4</sup>

SRM Valliammai Engineering College, Chennai, India

**Abstract:** An electrical vehicle charging station is a charging power supply for electrical vehicles. This paper proposes design of a model for a PV based electrical vehicle that forecasts total power output under particular conditions of Ankara city. First PV cell parameters are determined and then PV array formed including cells designed in order to calculate cumulative effect. Using actual irradiation and temperature values we try to catch an approximation of output power for the future needs. Electric vehicles offer many advantages ranging from easy access and abundance of electrical energy sources. The objective of this paper is to obtain the best configuration of the hybrid power systems for charging station in a rural area such as Labuan bajo, Indonesia. Thus, the best configuration obtained is then installing with three types of energy storage namely Lead Acid and UNS Lithium battery such as Lithium Ion and Lithium Ferro Phosphate (LFP) to determine the minimum cost of operation and energy cost in a year. The results showed by implementing hybrid systems from PV and DER is the best configuration for off grid charging station. The most optimal battery in off grid system achieved by installing UNS LFP batteries. As a conclusion, by utilizing hybrid power generation technology, the potential for renewable energy in rural areas can be the main key in realizing the availability of charging stations in rural areas with affordable price for supporting electric vehicles infrastructure.

**Keywords:** Photovoltaic (PV), Lithium Ferro Phosphate (LFP), Electric Vehicles (EVs), Three-port Integrated Topology (TPIT), Distributed Energy Resource(DER)

## I. INTRODUCTION

Electric vehicles (EVs) are recognized as one of the most efficient modes of transportation with zero trailing emission. Considering the advantage of EVs, 3 million vehicles are already deployed on the road, and it is expected to cross 100 million by 2030. However, the execution of proposed plan demand for huge charging infrastructure and enormous electrical energy. Moreover, EVs can only be sustainable when the electrical energy required for charging is generated from renewable and sustainable energy sources. However, the use of fossil fuels for electricity generation, does not reduce the emission but merely shift it from vehicles to the power plant. Therefore, the use of renewable energy sources for electricity generation can completely eliminate the emission and provides an environmental benefit. Among various available renewable energy sources, solar PV array, wind energy, hydro energy and fuel cell based energy, solar PV based generation is a most feasible solution for EV charging because it is available almost everywhere irrespective of the rural or urban region. As far as the Indian region is concerned, it is available almost throughout the year. On the contrary to the solar PV array, the wind and hydro energies are location specific. The wind energy is mostly useful in the coastal region, and hydro energy is useful for hilly region. Though, the renewable energy based charging stations are the most feasible solution for the EV charging, however, their integration to the existing charging system introduces the additional power conversion stage, which increases the complexity and power loss in the system. Moreover, each conversion stage needs an individual controller, which needs to be integrated with the existing control. Therefore, it is imperative to design an integrated system with multifunctional and multimode operating capability, for which a unified control and coordination between the various sources are essential. Many efforts have been made to develop the renewable energy based charging station. Ugirumurera et al. have discussed the importance

of renewable energy for the sustainability of the EV charging station

Renewable energy based charging station, are mostly focusing on the optimization of different aspects of charging such as the size of the renewable energy sources, size of the storage unit, vehicle driving pattern, charging time, charging cost, charging scheduling etc. However, in present scenario only few publications have actually implemented the charging station using renewable energy sources. Moreover, the performance of charging station under real circumstances, is also less discussed. Moreover, in most of the literature, the performance of CS, is discussed only in either grid connected mode or islanded mode. However, due to the single mode of operation in grid connected mode, the solar PV panel becomes unusable if the grid is not available even if the sun (solar irradiance) is available. Similarly, in islanded mode, the PV power is disturbed by the intermittency of solar irradiance. Therefore, a storage battery is required for mitigating the effect of variable solar irradiance. However, in case of the fully charge storage battery, the maximum power point tracking (MPPT) has to be disabled to avoid the overcharging of the storage battery. Therefore, in this paper, a PV array, grid, energy storage and DG set supported CS is presented, which operates in islanded, grid connected and DG set connected modes, so that the PV array energy is utilized for all operating conditions. Some publications [15] have discussed both islanded and grid connected modes. However, these two modes are controlled separately and the automatic mode switching between two modes are not presented. Therefore, without automatic mode switching capability, the PV array power is to be interrupted and the charging of the EV is not to be continuous. Therefore, in this paper, an automatic mode switching logic is presented, so that the controller automatically switches between different operating modes depending on the power generation of PV array and the charging demand of EV. Due to the unavailability in the night and the intermittent nature of the PV array, storage battery with PV array is used for continuous and reliable operation of CS. However, due to the limited storage capacity of the storage battery, it is hardly possible to provide backup all the time. Therefore, the CS needs support of the grid in case of PV array energy is unavailable, and energy storage is also discharged. However, due to the limited availability of grid, especially in remote areas, the DG set may be required for maintaining the continuity of the charging.

## **II. PHOTOVOLTAIC SYSTEM**

The modeling of the Photovoltaic system is done with MATLAB SIMULINK. The system consists of a photovoltaic panel, boost converter, a resistive load and Butterfly optimizer and a single-phase inverter.


### **2.1 Operating Principle**

Solar cells are the basic components of photovoltaic panels. Most are made from silicon even though other materials are also used.

Solar cells take advantage of the photoelectric effect: the ability of some semiconductors to convert electromagnetic radiation directly into electrical current. The charged particles generated by the incident radiation are separated conveniently to create an electrical current by an appropriate design of the structure of the solar cell, as will be explained in brief below. For further details, the reader can consult references [4] and [10].

#### **A. Solar Cell**

A solar cell is basically a p-n junction which is made from two different layers of silicon doped with a small quantity of impurity atoms: in the case of the n-layer, atoms with one more valence electron, called donors, and in the case of the p-layer, with one less valence electron, known as acceptors. When the two layers are joined together, near the interface the free electrons of the n-layer are diffused in the p-side, leaving behind an area positively charged by the donors. Similarly, the free holes in the p-layer are diffused in the n-side, leaving behind a region negatively charged by the acceptors. This creates an electrical field between the two sides that is a potential barrier to further flow. This electric field pulls the electrons and holes in opposite directions so the current can flow in one way only: electrons can move from the p-side to the n-side and the holes in the opposite direction. A diagram of the p-n junction showing the effect of the mentioned electric field is illustrated in below figure.

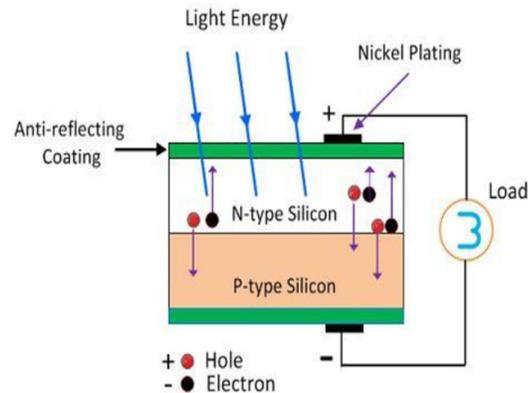

**Figure 1:** Solar cell

Metallic contacts are added at both sides to collect the electrons and holes so the current can flow. In the case of the n-layer, which is facing the solar irradiance, the contacts are several metallic strips, as they must allow the light to pass to the solar cell, called fingers.

### B. MPPT Controller

- Maximum power point tracking (MPPT) is a technique used to maximize energy extraction.
- Maximum power point tracking (MPPT) is an algorithm implemented in photovoltaic (PV) inverters to continuously adjust the impedance seen by the solar array to keep the PV system operating at, or close to, the peak power point of the PV panel under varying conditions.
- Output of boost converter is compared with previous power of the module. Duty cycle is adjusted to track the Max Power Point. It continuous until the power of the PV reaches the max.
- The condition at which Max power is transferred to the load is

$$R_L = R_{\text{solar cell}}$$


### III. WIND TURBINE

The supply is not reliable and sustainable. So this type of problem can be overcome by using a hybrid system, which is a system that combines aspects of renewable energy, such as solar and wind turbine simultaneously. Hybrid power systems can be defined as a combination of different energy sources. Complementary energy generation systems can be provided by renewable or mixed energy (with reserves from DER). The hybrid system provides better features of each energy resource compared to conventional sources and also provides electricity. The main advantage of hybrid systems is when a resource is lack for supporting energy, other resource can be supported as a main energy source. Solar panels are less effective on cloudy and windy days so they will produce lower energy levels while wind generators can produce a lot of energy. Similarly, for wind power plants the main problem is the location of the plant which has a certain amount of wind regularly. The main use of non-conventional energy makes this system almost independent and reduces energy prices in the long run, and a combination of diesel generators is used as a backup in emergencies such as high loads or low availability of renewable power [2]. A rural area may provide many natural potentials energy resources that gives a lot of benefits. The availability of renewable energy in rural areas is the main key in realizing the distribution of electric vehicle technology and increasing the electrification ratio. With renewable energy, a reliable power plant can be built by combining natural components as the main potential of electrical energy sources. By utilizing solar, wind and small-scale DER, construction of charging stations infra structure for EV can be realized especially to support implementation of electric vehicle technology and reducing consumption of fossil energy for transportation. From the historical point of view the idea of electric drive for propulsion propeller isn't new. In the end of the 19<sup>th</sup> century in some countries such as Russia and Germany took place experiments which were directed for designing vessels with electric propulsion (EP) drives (electric power transmission).


#### 3.1 Contemporary Propulsion Systems

By the moment in the world the most widespread propulsion systems are:


- Diesel-mechanical (Diesels engines through a gear connected to a shaft and consequently to a propeller), Fig.2
- Conventional diesel-electric arrangement (Diesel engines (sometimes as prime mover may be used a steam turbine in a nuclear-powered ships) – electric generators – distribution and energy delivering system – electric motor-gear-shaft-propeller), Fig. 3
- Pod propulsion- so called azimuth thrusters (Prime movers – electric generators – distribution, delivering and energy conversion system – podded motors with on shaft propellers), Fig. 4

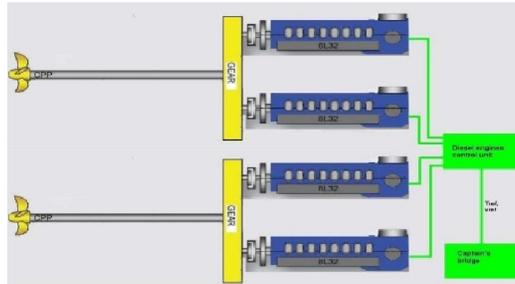

**Figure 2:** Typical Diesel Mechanic Propulsion System

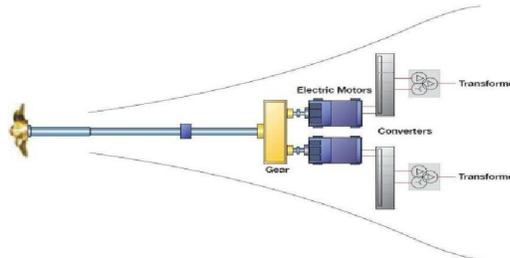

**Figure 3:** Conventional diesel-electric arrangement [2]

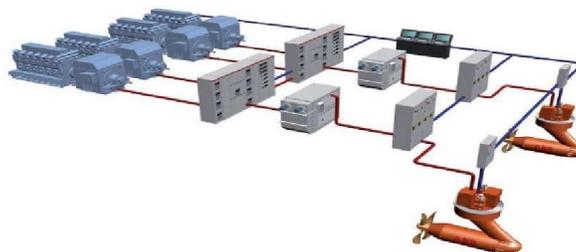

**Figure 4:** Podded propulsion

Nowadays, the electric propulsion is used in more and more application areas and replaces the classical mechanical configuration. In most cases azimuth thrusters or combined assemblies are used. Electrical propulsion is applied in a wide range of vessels such as: icebreakers, drilling vessels, cruise vessels, shuttle tankers, cable and pipe layers, war ships. Such a wide spread got a reality because of advantages inherent EP:

1. Reduced consumption of the fuel, especially, in maneuvering operation modes
2. Reduced maintenance cost due to flexible and smooth operating, avoiding jerky torque and speed change, decreasing tear modes
3. Optimized load of prime mover (prime mover operates at rated parameters and life cycle is prolonged)
4. Decreased vibrations (absence long shaft) and noise (important on cruise vessels)
5. Higher level reliability directed for preventing blackouts
6. Opportunity to locate power equipment properly based on load in different vessel's parts
7. Mounting places of thrusters are not restricted because of delivering energy via cables

Typical efficiency of each component of the power system in the power level of ship components:



1. Generator: 95 – 97 %
2. Switchboard: 99.99 %
3. Transformer 99.1 – 99.7 %
4. Frequency converter 95 – 99 %
5. Electric motor 93 – 97 %

IV. EV CHARGING STATION

A charging station, also called an EV charger or electric vehicle supply equipment (EVSE), is a piece of equipment that supplies electrical power for charging plug-in electric vehicles (including hybrids, neighborhood electric vehicles, trucks, buses, and others).

Although batteries can only be charged with DC power, most electric vehicles have an onboard AC-to-DC converter that allows them to be plugged into a standard household AC electrical receptacle. Inexpensive low-power public charging stations will also provide AC power, known as "AC charging stations". To facilitate higher power charging, which requires much larger AC-to-DC converters, the converter is built into the charging station instead of the vehicle and the station supplies already-converted DC power directly to the vehicle, bypassing the vehicle's onboard converter. These are known as "DC charging stations". Most fully electric car models can accept both AC and DC power.

The terms "electric vehicle connector" and "electric vehicle inlet" were previously defined in the same way under Article 625 of the National Electric Code (NEC) of 1999. NEC-1999 also defined the term "electric vehicle supply equipment" as the entire unit "installed specifically for the purpose of delivering energy from the premises wiring to the electric vehicle", including "conductors ... electric vehicle connectors, attachment plugs, and all other fittings, devices, power outlets, or apparatuses".

V. RESULTS AND DISCUSSION



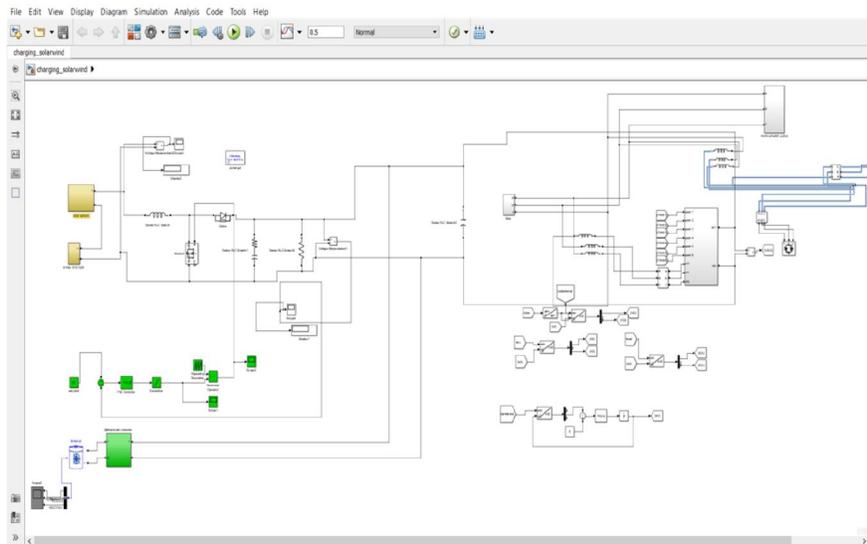



Figure 6: Hybrid power plant design

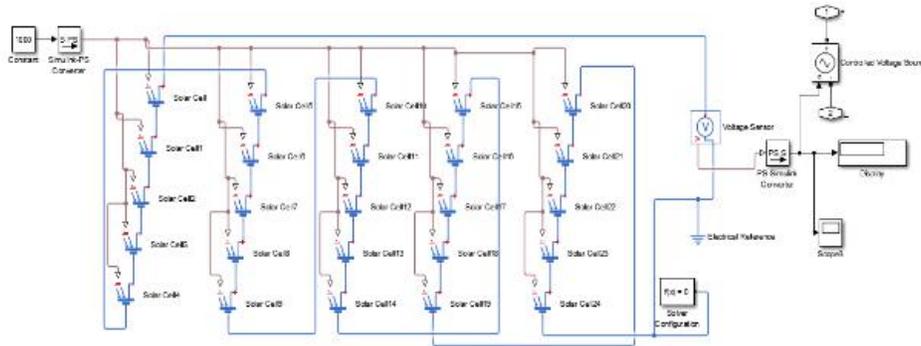

**Figure 7: Hybrid power plant design**

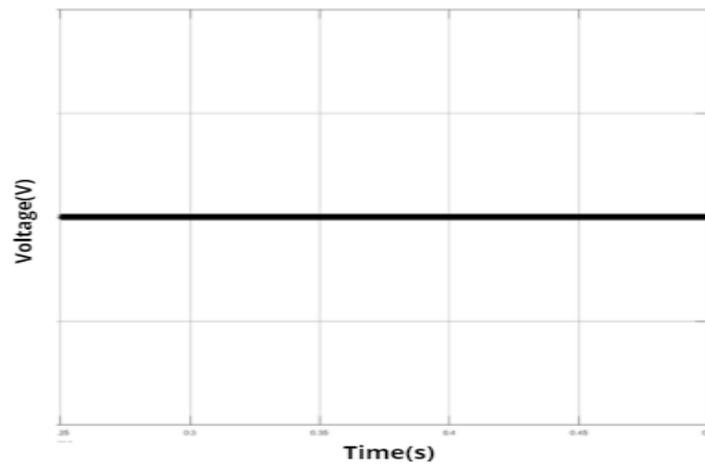

**Figure 8: Solar voltage**

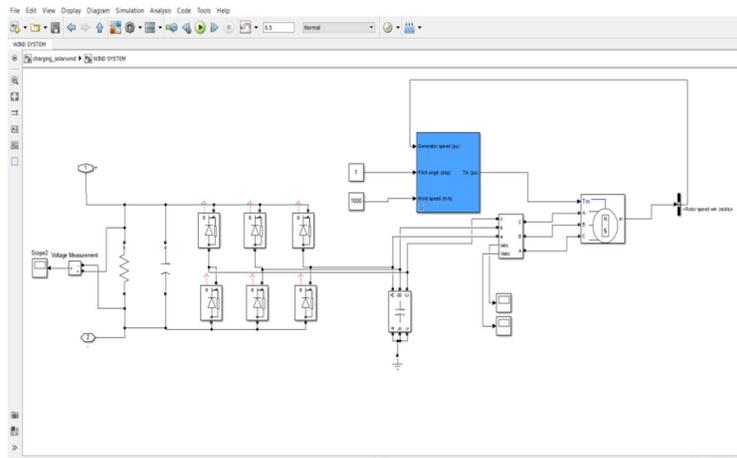

**Figure 9: Wind design**

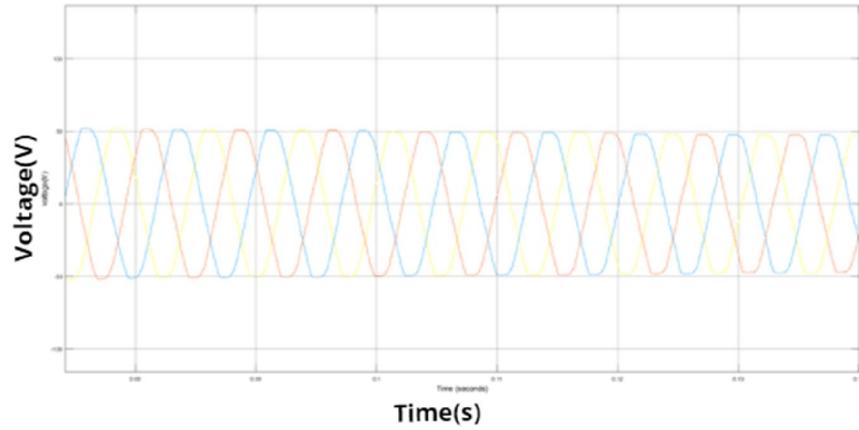


Figure 10: Wind Output Voltage

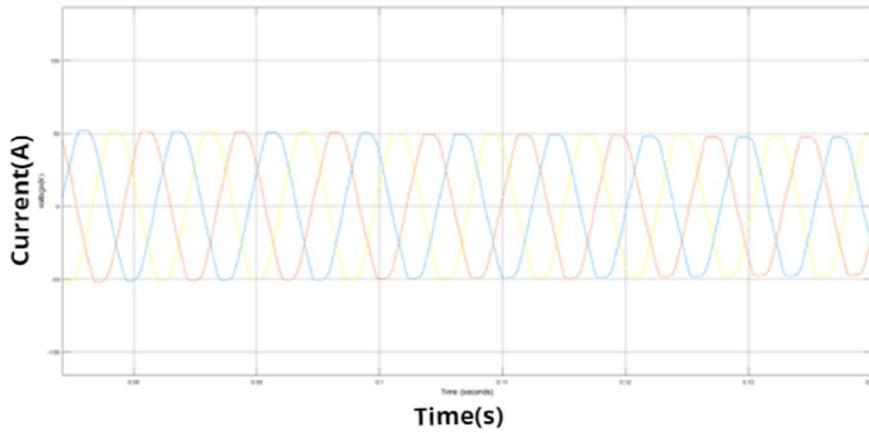


Figure 11: Wind Output current



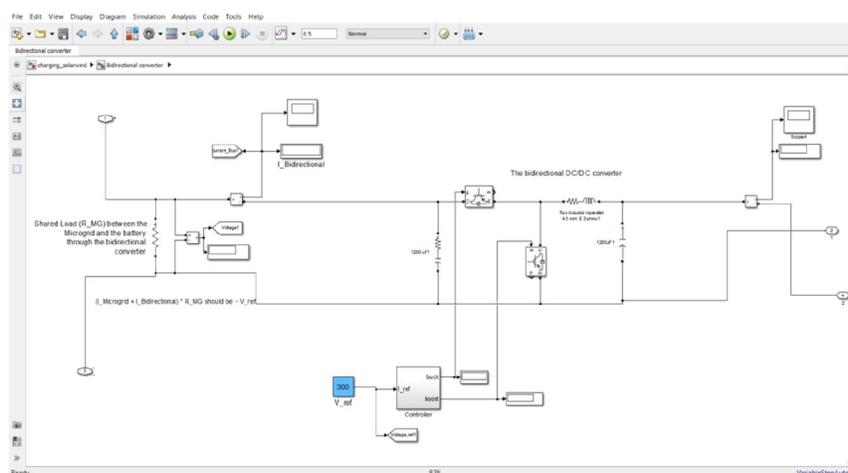



Figure 12: Bidirectional converter

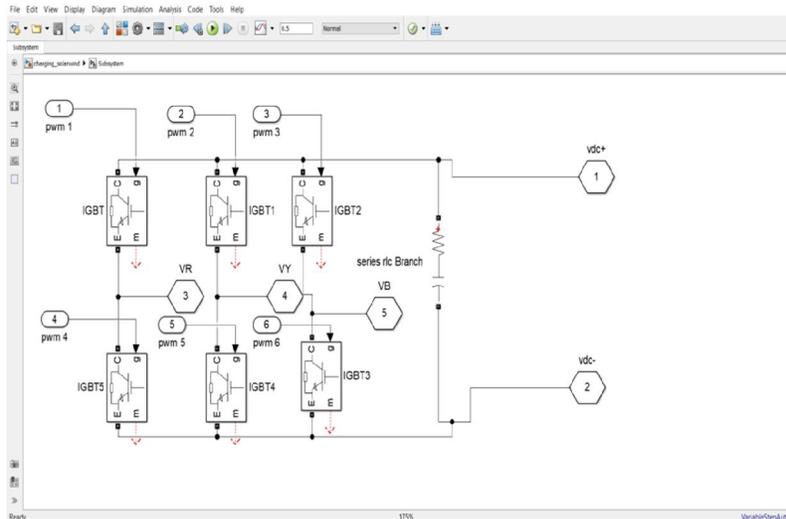


**Figure 14: Inverter design**

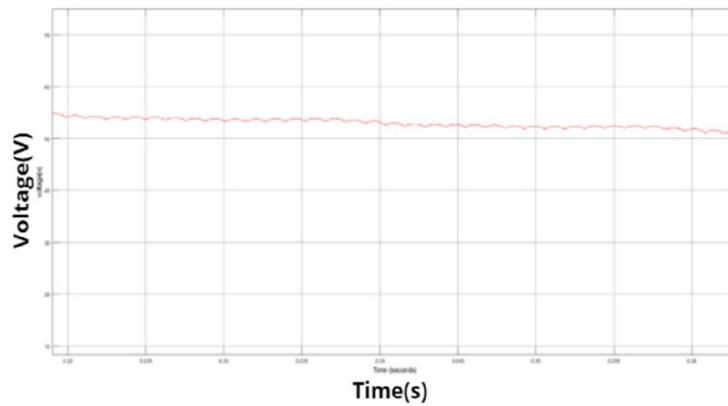

**Figure 15: Hybrid voltage**

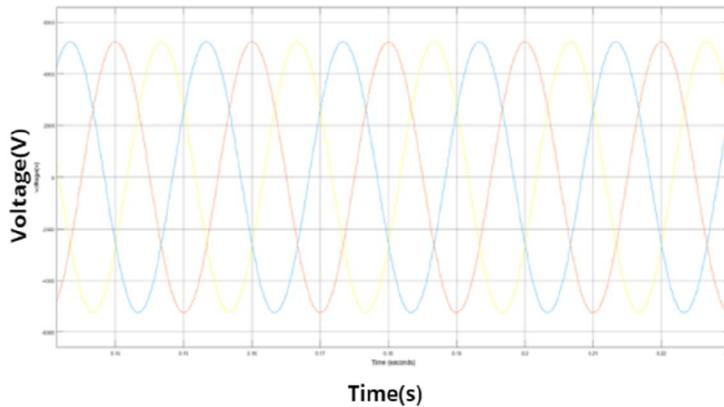

**Figure 16: Load voltage**

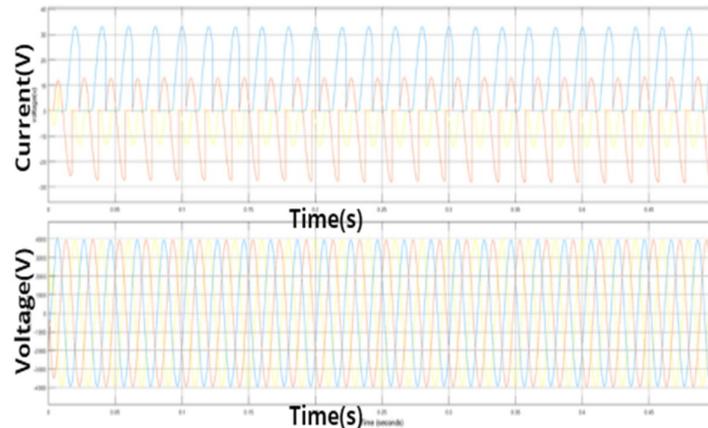

**Figure 17:** Electric vehicle voltage and current

## VI. CONCLUSION

**Figure** An implementation of PV array, storage battery, grid and DG set based charging station has been realized for EV charging. The presented results have verified the multimode operating capability (islanded operation, grid connected and DG set connected) of the CS using only one VSC. change in the EV charging current and change in the loading. The operation of charging station as a standalone generator with good quality of the voltage, has been verified by the presented results. Whereas, test results in DG set or grid connected mode, have verified the capability of ANC based control algorithm to maintain the power exchange with the grid at UPF or the optimum loading of the DG set. Moreover, the islanded operation, grid connected and DG set connected operations along with the automatic mode switching have increased the probability of MPP operation of the PV array and optimum loading of DG set along with increasing the charging reliability. The IEEE compliance operation of the charging station with voltage and current THD always less than 5% verifies the effectiveness of the control. Form the above-mentioned point, it can be concluded that this charging station with the presented control have the capability to utilize the various energy sources very efficiently and provides the constant and cost effective charging to the EVs.

## REFERENCES

- [1]. International Energy Agency-Global EV Outlook 2018- Towards cross-modal electrification. [Online] Available: [https://webstore.iea.org/download/direct/1045?fileName=Global\\_EV\\_Outlook\\_2018.pdf](https://webstore.iea.org/download/direct/1045?fileName=Global_EV_Outlook_2018.pdf)
- [2]. International Energy Agency- Renewables 2018 - Analysis and Forecasts to 2023 [Online]. Available: <https://webstore.iea.org/download/summary/2312?fileName=EnglishRenewables-2018ES.pdf>.
- [3]. S ShravyaGeethika, D.Y. Kiran Kumar, "Design and Development Of Efficiency Controls For a Hybrid Electric Vehicle Under Adaptive Cruise Control Algorithm," *www.irjmets.com*, Volume:03/Issue:10/October-2021.
- [4]. G. R. Chandra Mouli, J. Schijffelen, M. van den Heuvel, M. Kardolus and P. Bauer, "A 10 kW Solar-Powered Bidirectional EV Charger Compatible WithChademo and COMBO," *IEEE Trans, Power Electron.*, vol. 34, no. 2, pp. 1082-1098, Feb. 2019.
- [5]. V. Monteiro, J. G. Pinto and J. L. Afonso, "Experimental Validation of a Three-Port Integrated Topology to Interface Electric Vehicles and Renewables With the Electrical Grid," *IEEE Trans. Ind. Informat.*, vol. 14, no. 6, pp. 2364-2374, June 2018.
- [6]. S. A. Singh, G. Carli, N. A. Azeez and S. S. Williamson, "Modeling, Design, Control, and Implementation of a Modified Z-Source Integrated PV/Grid/EV DC Charger/Inverter," *IEEE Trans. Ind. Electron.*, vol. 65, no. 6, pp. 5213-5220, June 2018.
- [7]. K. Chaudhari, A. Ukil, K. N. Kumar, U. Manandhar and S. K. Kollimalla, "Hybrid Optimization for Economic Deployment of ESS in PV-Integrated EV Charging Stations," *IEEE Trans. Ind. Informat.*, vol. 14, no. 1, pp. 106-116, Jan. 2018.

- [8]. F. Kineavy and M. Duffy, "Modelling and design of electric vehicle charging systems that include on-site renewable energy sources," in IEEE 5th Int. Symp. Power Electron. For Distributed Gene. Syst. (PEDG), Galway, 2014, pp. 1-8.
- [9]. Y. Zhang, P. You and L. Cai, "Optimal Charging Scheduling by Pricing for EV Charging Station With Dual Charging Modes," IEEE Trans. Intelligent Transportat. Syst., vol. 20, no. 9, pp. 3386-3396, Sept. 2019.
- [10]. Y. Yang, Q. Jia, G. Deconinck, X. Guan, Z. Qiu and Z. Hu, "Distributed Coordination of EV Charging With Renewable Energy in a Microgrid of Buildings," IEEE Trans. Smart Grid, vol. 9, no. 6, pp. 6253-6264, Nov. 2018.
- [11]. N. K. Kandasamy, K. Kandasamy and K. J. Tseng, "Loss-of-life investigation of EV batteries used as smart energy storage for commercial building-based solar photovoltaic systems," IET Electrical Systems in Transportation, vol. 7, no. 3, pp. 223-229, 9 2017.
- [12]. A. Tavakoli, M. Negnevitsky, D. T. Nguyen and K. M. Muttaqi, "Energy Exchange Between Electric Vehicle Load and Wind Generating Utilities," IEEE Trans. Power Sys., vol. 31, no. 2, pp. 1248-1258, 2016.
- [13]. Y. Shan, J. Hu, K. W. Chan, Q. Fu and J. M. Guerrero, "Model Predictive Control of Bidirectional DC-DC Converters and AC/DC Interlinking Converters - A New Control Method for PV-Wind-Battery Microgrids," IEEE Trans. Sustain. Energy, Early Access.
- [14]. P. Liu, J. Yu and E. Mohammed, "Decentralised PEV charging coordination to absorb surplus wind energy via stochastically staggered dual-tariff schemes considering feeder-level regulations," IET Gene., Trans. & Distri., vol. 12, no. 15, pp. 3655-3665, 28 8 2018.
- [15]. B. Singh, A. Verma, A. Chandra and K. Al-Haddad, "Implementation of Solar PV Battery and Diesel Generator Based Electric Vehicle Charging Station," in IEEE Int. Conf. Power Electronics, Drives and Energy Systems (PEDES), Chennai, India, 2018, pp. 1-6.
- [16]. N. Saxena, B. Singh and A. L. Vyas, "Integration of solar photovoltaic with battery to single-phase grid," IET Generation, Transmission & Distribution, vol. 11, no. 8, pp. 2003-2012, 1 6 2017.
- [17]. H. Razmi and H. Doagou-Mojarrad, "Comparative assessment of two different modes multi-objective optimal power management of micro-grid: grid-connected and stand-alone," IET Renewable Power Generation, vol. 13, no. 6, pp. 802-815, 2019.
- [18]. O. Erdinc, N. G. Paterakis, T. D. P. Mendes, A. G. Bakirtzis and J. P. S. Catalão, "Smart Household Operation Considering BiDirectional EV and ESS Utilization by RealTime Pricing-Based DR," IEEE Trans. Smart Grid, vol. 6, no. 3, pp. 1281-1291, May 2015.
- [19]. H. Kikusato, K. Mori, S. Yoshizawa, Yu Fujimoto, H. Asano, Y. Hayashi, A. Kawashima, S. Inagaki, T. Suzuki, "Electric Vehicle Charge-Discharge Management for Utilization of Photovoltaic by Coordination between Home and Grid Energy Management Systems," IEEE Trans. Smart Grid, Early Access.
- [20]. F. Hafiz, A. R. de Queiroz and I. Husain, "Coordinated Control of PEV and PV-based Storages in Residential System under Generation and Load Uncertainties," IEEE Trans. Ind. Applica., Early Access.
- [21]. R. W. Wies, R. A. Johnson, A. N. Agrawal and T. J. Chubb, "Simulink model for economic analysis and environmental impacts of a PV with diesel-battery system for remote villages," IEEE Trans. Power Systems, vol. 20, no. 2, pp. 692-700, May 2005.
- [22]. R. R. Chilipi, N. Al Sayari, A. R. Beig and K. Al Hosani, "A Multitasking Control Algorithm for Grid-Connected Inverters in Distributed Generation Applications Using Adaptive Noise Cancellation Filters," IEEE Trans. Energy Conversion, vol. 31, no. 2, pp. 714-727, June 2016.
- [23]. A. Ghosh and V. Aggarwal, "Control of Charging of Electric Vehicles Through Menu-Based Pricing," IEEE Transactions on SmartGrid, Vol.9, No.6, pp.5918-5929, 2018, DOI: 10.1109/TSG.2017.2698830.
- [24]. S. Venkatesh, R. Karthik, "A Review Study on Grid-Tied Inverters for Renewable Energy systems", imanager's Journal on Circuits and Systems Vol. No. 1, 9 January - June 2021.
- [25]. V. Vasanthi, M. Vaideki, Rajesh Kumar, Pradeep Kumar and S. Venkatesh, "Multi Parameter Monitoring in solar Panel with IOT", International Journal of Scientific Research and Engineering Development, Vol-3, Issue 2, pp.134-138, March, 2020.
- [26]. B. Abilash, G. aravindraj, S. Kirushma, B. Derin, S. Venkatesh, "IOT Based Solar Power Monitoring System", International Research Journal of Engineering and technology, Vol-6, Issue 3, , pp.1956-1959, March 2019.